

An example of wind turbine structure

Marija Jelčić, M.Eng.C.E.

Mladen Kožul

University of Mostar, Faculty of Civil Engineering, Ph.D C.E.

mladen.kozul@gf.sum.ba

Abstract: The purpose of this paper is to develop structural design of a wind turbine foundation and tower. The structural modeling was performed in program Tower 7. All structural elements are calculated according to the applicable regulations of Eurocode and National Annexes. The structure consists of a steel tower calculated in segments and a reinforced concrete foundation made in a monolithic design. The wind turbine tower is a steel tubular tower, while the foundation is made of reinforced concrete in a circular shape.

Keywords: structure, load, structural calculation, formwork plan

Primjer konstrukcije vjetroagregata

Sažetak: Cilj ovog rada je izrada projekta konstrukcije temelja i stupa vjetroagregata. Modeliranje konstrukcije izvršeno je u računalnom programu Tower 7. Svi konstruktivni elementi su proračunati prema važećim propisima Eurocode-a i Nacionalnim dodacima. Konstrukcija se sastoji od čeličnog stupa proračunatog u segmentima te armiranobetonskog temelja izvedenog monolitnom izvedbom. Stup vjetroagregata je čelični cjevasti, dok je temelj armirano betonski, kružnog oblika.

Ključne riječi: konstrukcija, opterećenje, statički proračun, plan oplata

1. INTRODUCTION

At the present time with growing awareness of the need to preserve the environment and reduce conventional energy production methods, there is a great interest of experts in the possibility of using alternative energy sources such as wind, solar, biodiesel and the like. Reserves of fossil fuels are disappearing faster and faster, climate change is becoming increasingly pronounced, and the use of energy obtained from renewable sources is becoming increasingly needed, and so wind energy, among others, is a great help and relief. In this paper, attention is focused on the construction method of a wind turbine foundation and tower.

The simplest definition describes a wind power plant as a group of closely positioned wind turbines, usually of the same type, exposed to wind of the same characteristics and connected to the electric power system. Wind turbines are rotating machines that convert the kinetic energy of wind into mechanical and then through electrical generators into electrical energy.

The use of wind energy dates back to a distant history when people traveled long distances by sailing ships, the success of which depended precisely on the renewable energy source - wind. From those ancient times until today, some of the maritime transport means still navigate in exactly the same way, using the same energy source. The earliest known case of wind energy use dates from the 1st century, when Heron's wind wheel was used to power an organ (Figure 1).

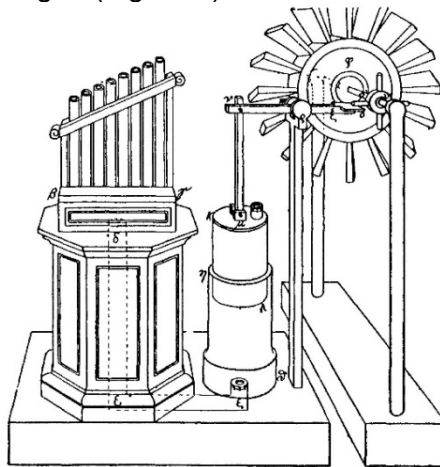


Figure 1. Heron's wind wheel

The first windmills for practical use are believed to have appeared as early as in the 7th century in the area between Afghanistan and Iran (Figure 2), and were characterized by a vertical position of the rotation axis and rectangular sails. They were used to grind grain and pump water. Today, the development of wind power plants and the wind industry are growing at an enormous pace. The dimensions have increased approximately twice, and the generator powers have certainly increased tenfold (Figure 3).

In Europe, a capacity of approximately 134.6 GW of wind energy is presently available, of which 94% is accounted for onshore wind turbines and the remaining 6% for offshore wind turbines. European Union countries are aiming to achieve the target of 20% energy from renewable sources already by this year. In order to achieve this target, each country has been adopting national laws and regulations relating to this subject.

Energy issues, especially those on renewable energy sources, have become very

Jelčić, M., Kožul, M.

An example of wind turbine structure

important not only because of the poor environmental condition, but also because of the ever-increasing energy needs. Thus, for example, in the Netherlands, wind energy has been used for centuries now to drain wetlands, cut timber and exploit oil (Figure 4).



Figure 2. Windmill, 7th century

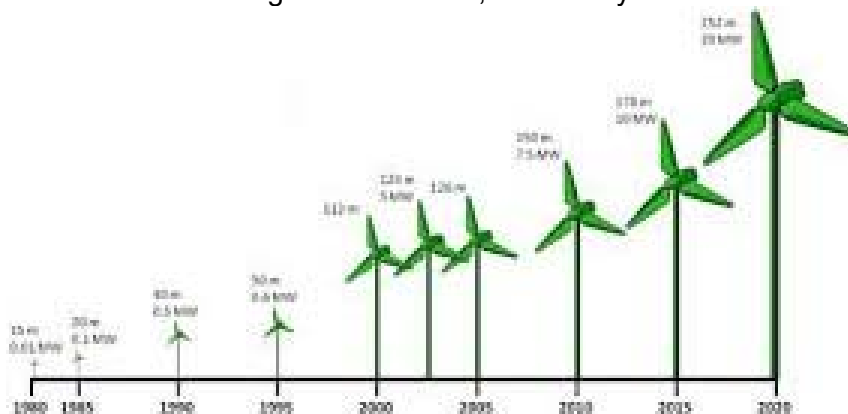


Figure 3. Progress in building wind power plants through the decades



Figure 4. View of an offshore wind farm in the Netherlands

2. SOME TECHNICAL AND COMPUTATIONAL CHARACTERISTICS OF THE WIND TURBINE

The altitude of the wind turbine is about 1500.0 meters. It consists of a steel tower, operating part - blades and a nacelle, and a foundation. The wind turbine tower is a steel tube 78 meters in height. The width of the tower varies, from 4240 millimeters at the connection with the foundation, to 2302 millimeters at the contact with the power-generating part of the wind turbine. The tower wall thicknesses range from 24 millimeters (27 mm) at the bottom of the tower to 15 millimeters (18.20 mm) at the top.

The tower consists of segments welded together to form three elements, which are interconnected by flanges and bolts. The joints are made of high-strength bolts (VV) of strength class 10.9 distributed as follows: 120 M39 on the base along the upper and lower foundation ring and 142 M42 and 98 M42 on the flanges. The bolts on the flanges are pretensioned with a force $F_p=710$ kN. The quality of steel of the tower jacket is S355 K2+N and S355 J2+N.

The wind turbine tower structure is calculated for two groups of loads. The extreme loads occurring during operation of the turbine ("Extreme loads") are taken into account first. The horizontal forces at the joint between the tower and the foundation are -755.8 kN (greater) and -21.4 kN (smaller), respectively, while the maximum vertical force is 2486 kN. The maximum torsional moment is 926 kNm, while the bending moments transferred from the tower to the foundation are 56404.9 kNm and 2157.9 kNm, respectively.

The second group of loads, the action of which is analyzed, is the group of loads from the action of wind. The relevant wind load was obtained on the basis of the wind turbine location according to the wind speed map (10 minutes at a height of 10 m for a 50-year return period) with HRN EN 1991-1-4:2012+NAD., on the very border of the Republic of Bosnia and Herzegovina with the Republic of Croatia. For this zone, the basic reference velocity $v_{b,0}$ is 30 m/s, which gives a pressure $q_{b,0}$ of 0.56 kN/m², and with the coefficient of exposure (c_e) of 4 for terrain category I gives the velocity of 60 m/s.

The calculation gave the natural period of the structure $T=3.28$ sec, which resulted in a dynamic coefficient, with which the base load was increased by 50% (rotor and nacelle are assumed as a concentrated mass at the top of the tower in the amount of 1175 kN, the rotor mass is 44 tons, and the nacelle mass 72.5 tons).

The input value of wind speed of 60 m/s was used in the calculation, which was then corrected by three values related to the dynamic properties, shape, and size of the tower surface.

The value obtained by calculating the wind load at the level of the connection between the foundation and the wind turbine is 66583 kNm (this value is slightly smaller than the overturning moment, which is about 70 thousand kNm).

Therefore, the calculation was performed with the speed of 60 m/s as an accidental load, and with 40 m/s in a constant combination and the corresponding coefficients. A speed of 40 m/s was selected as the reference maximum ten-minute mean wind speed.

3. LOADS AND COMBINATIONS

It is usual to verify the safety of a structure for the ultimate limit state, serviceability limit state and accidental limit state.

The structure is loaded with the following load cases:

1. Permanent
2. Ice
3. Wind 40 m/s

Jelčić, M., Kožul, M.

An example of wind turbine structure

4. Wind 60 m/s
5. Earthquake in the x-direction
6. Earthquake in the y-direction

The earthquake is calculated in both directions only to prove the correctness of the calculation, because the same value is expected in both directions for a symmetrical structure and a system with one degree of freedom.

The following load combinations are taken:

1. 1.35*Permanent + 1.5*ice
2. 1.35*Permanent + 1.5*wind 40 m/s
3. 1.0*Permanent + 1.0*wind 60 m/s
4. 1.0*Permanent + 1.0*ice + 1.0*earthquake (x)
5. 1.0*Permanent + 1.0*ice + 1.0*earthquake (y)

The ice load was taken in the amount of 15% of the dead weight of the structure, at the top as 15% of the concentrated load from the nacelle and blades ($0.15 \times 1175 \text{ kN} = 176 \text{ kN}$), and along the tower as a line load in the amount of 3 kN/m (15% of approx. 20 kN/m tower mass).

Furthermore, the building was also calculated for the effect of seismic ground motion, according to HRN EN 1998-1:2011, assuming the design ground acceleration a_g/g of 0.30 (according to the map with HRN EN 1998-1:2011/NA:2011), minimum value of the behavior factor q of 1.5 and soil category B with associated values. Spectrum type 1 was used because earthquakes with a surface wave magnitude of more than 5.5 on the Richter scale are expected. The importance factor $\gamma = 1.0$ was adopted.

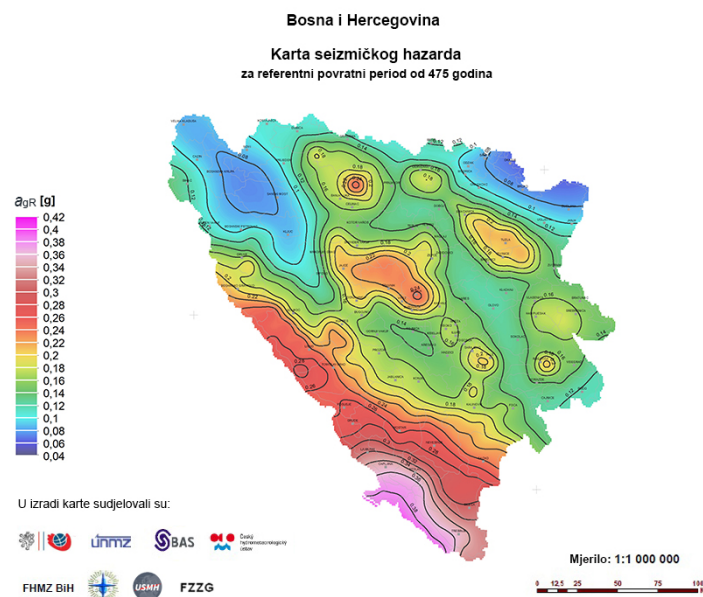


Figure 5. Seismic hazard map

The foundation is a reinforced concrete circular one, 18 m in diameter, 2.0 m in height, with a circular elevation of 50 cm in the middle with a diameter of 560 cm. The relevant load for dimensioning the foundation is the wind turbine load by the current wind speed.

The foundation soil is limestone rock, the minimum bearing capacity of which exceeds 1000 kN/m^2 . The foundation is designed with concrete class C30/37 (except the top part C35/45) and is cross reinforced in both zones with deformed bars B500B, with 10 cm thick class C20/25 concrete bedding. The protective concrete layer is 5 cm.

4. ANALYSIS OF LOADS

4.1 Data on basic actions

The basic actions for which the mechanical resistance and stability of the structure are proven are divided according to the following:

- permanent action (G) - dead weight of the structure
- additional permanent action
- variable action (Q)
- accidental action (E)

4.1.1 Vertical loads

Dead weight of the structure

The dead weight of load-bearing elements of the structure is determined on the basis of dimensions of the elements and specific weights of the materials from which the elements are made. The specific weight of steel is 78.50 kN/m^3 and is generated by computer calculation. In the TOWER 7 software package, dead weight is automatically included.

Weight of equipment and antennas



The replacement weight for the equipment (nacelle) and rotors at the top of the tower is taken in the amount of 1191 kN (rotor 471 kN and nacelle 720 kN).

Weight of ice

According to DIN 4131, icing of the structure 3 cm in thickness was assumed, and the specific weight of ice was taken as $\gamma_L = 8.0 \text{ kN/m}^3$.

From the ratio of the thickness of the ice and of the corresponding steel profile wall and the ratio of their specific weights, it can be assumed that the corresponding weight of ice is approximately equal to $\frac{1}{2}$ the weight of the steel structure, i.e.:

$$g_{\text{ice}} \approx \alpha \times g_{\text{steel}} \approx 0.5 g_{\text{steel}} \quad \text{where} \quad \alpha \approx \frac{\alpha_\phi + \alpha_L}{2} \approx \frac{0.4 + 0.6}{2} \approx 0.5$$

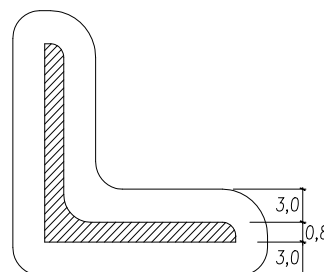

$$\alpha_\phi \approx \frac{d_L \times \gamma_L}{d_c \times \gamma_c} \approx \frac{3.0 \times 8.0}{2.35 \times 78.5} \approx 0.15 \quad \alpha_L \approx \frac{d_L \times \gamma_L}{d_c \times \gamma_c} \approx \frac{2 \times 3.0 \times 0.7}{0.8 \times 78.5} \approx 0.6$$

4.1.2 Horizontal loads

Wind load

The action of wind is compared according to Croatian and German regulations, and further analysis of wind action is performed according to DIN 4131:

$$w = f_B \times c_f \times w_0 \times A$$

According to DIN 4131, the dynamic factor f_B was taken for the action of wind on the structure with $f_B = 1.5$ for $T = 3.28$ s, which was obtained by modal analysis of the tower structure with the software package TOWER 7.

$$\begin{aligned} \eta &= 1.05 - h/1000 = 1.05 - 75.9/1000 = 0.9741 \rightarrow \eta = 0.98 \text{ taken} \\ f_B^0 &= 1 + (0.042 T - 0.0019 T^2) \times \delta^{-0.63} = 1.499 \text{ where } \delta = 0.1 \\ f_B &= \eta \times f_B^0 = 0.98 \times 1.499 = 1.469 \rightarrow f_B = 1.5 \text{ taken} \end{aligned}$$

Basic wind load

The basic wind load caused by the wind speed of $v_{\max} = 60$ m/s was assumed, which is slightly higher than the maximum expected current wind speed according to the data. The speed is related to a return period of 50 years (Class IIA wind power plants), for an average of 3 seconds, and is 59.5 m/s. Otherwise, the facility is located in the immediate vicinity of the wind zone with $v_{b,0}$ of 30 m/s (on the very border with the Republic of Croatia) according to HRN EN 1991-1-4:2011+NAD NA: 2011, which is 0.56 kN/m², and which, when multiplied by the coefficient of exposure $c_e = 4$ (terrain category I, height 80m) gives 2.24 kN/m², almost identical to the pressure value for the assumed speed of 60 m/s.

$$w_0 = \frac{v_{\max}^2}{1600} = 2.25 \left[\text{kN/m}^2 \right]$$

The value of $w_0 = 2.3$ kN/m² was assumed for the calculation. The action of wind on the ice-free structure and on the icy structure with wind load reduced by the coefficient of 0.75 is observed. The wind load on the structure is determined by the expression:

$$w = f_d \times c_f \times w_0 \times A \text{ where } c_f = \psi \times c_{f0}$$

f_d – dynamic factor (1.5)

w_0 – basic respective wind load (2.3kN/m²)

A – corresponding wind exposed surface

c_{f0} – basic shape coefficient (1.2)

c_f – corrected shape coefficient

ψ – reduction factor dependent on slenderness and fullness (0.75)

Wind load by tower height

Determining factor λ for heights above 50 m:

$$\lambda = 0.7 \times \frac{h}{b} = 0.7 \times \frac{75.9}{3.52} = 15.1$$

Jelčić, M., Kožul, M.

An example of wind turbine structure**Segment III, upper part of the tower**

$$75.9 \text{ m} > h_3 > 46.5 \text{ m}; l_3 = 29.4 \text{ m}; b_3 = 2.76 \text{ m} \quad (b_3^* = 2.82 \text{ m})$$

The corresponding basic wind load, $w_0 = 2.3 \text{ kN/m}^2$

	Exposed surfaces - ice-free	Exposed surfaces - icy
Tower	$29.4 \times 2.76 = 81.1 \text{ m}^2$	$29.4 \times 2.82 = 82.9 \text{ m}^2$
Nacelle blades	$(48.5 + 24.2) \times 1.00 = 72.7 \text{ m}^2$	$(48.5 + 24.2) \times 1.06 = 77.1 \text{ m}^2$
	$14.0 \times 3.50 = 49.0 \text{ m}^2$	$14.0 \times 3.56 = 49.8 \text{ m}^2$
	$A_0 = 202.8 \text{ m}^2$	$A_0^* = 209.8 \text{ m}^2$

Blades + nacelle $A_0 = 121.7 \text{ m}^2$

Blades + nacelle $A_0 = 126.9 \text{ m}^2$

CONCENTRATED FORCE AT THE TOP OF THE TOWER:

$$H = 1.5 \times 1.2 \times 121.7 \times 2.3 = 503.8 \text{ kN}$$

$$H = 1.5 \times 1.2 \times 126.9 \times 0.75 \times 2.3 = 394.0 \text{ kN}$$

Tower, $\varphi = 1$

$$\lambda = 15.1$$

$$\Psi = 0.75 \quad c_{f0} = 1.2$$

$$c_f = \Psi \times c_{f0} = 0.75 \times 1.20 = 0.90$$

$$w_3 = 1.5 \times 0.90 \times 81.1 \times 2.3 / 29.4$$

$$w_3 = 8.56 \text{ kN/m}$$

adopted ... $w_3 = 8.6 \text{ kN/m}$

$$\lambda = 15.1$$

$$\Psi = 0.75 \quad c_{f0} = 1.2$$

$$c_f = \Psi \times c_{f0} = 0.75 \times 1.20 = 0.90$$

$$w_3^* = 1.5 \times 0.90 \times 82.9 \times (0.75 \times 2.3) / 29.4$$

$$w_3^* = 6.67 \text{ kN/m}$$

adopted ... $w_3^* = 6.6 \text{ kN/m}$

Segment II, middle part of the tower

$$46.5 \text{ m} > h_2 > 19.0 \text{ m}; l_2 = 27.5 \text{ m}; b_2 = 3.73 \text{ m} \quad (b_2^* = 3.79 \text{ m})$$

The corresponding basic wind load, $w_0 = 2.3 \text{ kN/m}^2$

	Exposed surfaces - ice-free	Exposed surfaces - icy
Tower	$27.5 \times 3.73 = 102.6 \text{ m}^2$	$27.5 \times 3.79 = 104.2 \text{ m}^2$
	$A_0 = 95.5 \text{ m}^2$	$A_0^* = 97.2 \text{ m}^2$

Tower, $\varphi = 1$

$$\lambda = 15.1$$

$$\Psi = 0.75 \quad c_{f0} = 1.2$$

$$c_f = \Psi \times c_{f0} = 0.75 \times 1.20 = 0.90$$

$$w_2 = 1.5 \times 0.90 \times 102.6 \times 2.3 / 27.5$$

$$w_2 = 11.58 \text{ kN/m}$$

adopted ... $w_2 = 11.6 \text{ kN/m}$

$$\lambda = 15.1$$

$$\Psi = 0.75 \quad c_{f0} = 1.2$$

$$c_f = \Psi \times c_{f0} = 0.75 \times 1.20 = 0.90$$

$$w_2^* = 1.5 \times 0.90 \times 104.2 \times (0.75 \times 2.3) / 27.5$$

$$w_2^* = 8.82 \text{ kN/m}$$

adopted ... $w_2^* = 8.8 \text{ kN/m}$

Jelčić, M., Kožul, M.

An example of wind turbine structure**Segment I, lower part of the tower**

0 m < h₁ < 19.0 m; l₁ = 19.0 m; b₁ = 4.28 m) (b₁^{*} = 4.36 m)

The corresponding basic wind load, w₀ = 2.3 kN/m²

Tower	Exposed surfaces - ice-free 19.0×4.28 = 81.3 m ² A _o = 81.3 m ²	Exposed surfaces - icy 19.0×4.36 = 104.2 m ² A _o [*] = 82.8 m ²
Tower, φ = 1		
λ = 15.1		λ = 15.1
Ψ = 0.75 c _{f0} = 1.2		Ψ = 0.75 c _{f0} = 1.2
c _f = Ψ × c _{f0} = 0.75 × 1.20 = 0.90		c _f = Ψ × c _{f0} = 0.75 × 1.20 = 0.90
w ₂ = 1.5 × 0.90 × 81.3 × 2.3 / 19.0		w ₂ [*] = 1.5 × 0.90 × 82.8 × (0.75 × 2.3) / 19.0
w ₂ = 13.28 kN/m		w ₂ [*] = 10.15 kN/m
adopted ... w ₁ = 13.3 kN/m'		adopted ... w ₁ [*] = 10.2 kN/m'

4.2 Combinations of loads**4.2.1 Basic loads**

Load 1. Permanent load = dead weight + rotor + nacelle

Load 2. Ice load

Load 3. Load by the wind of 40 m/s

Load 4. Load by the wind of 60 m/s

Load 5. Seismic action – direction x

Load 6. Seismic action – direction y

Combinations of loads

Combination 1. Permanent load + ice (1.35; 1.5)

Combination 2. Permanent load + wind 40 [m/s] (1.35; 1.5)

Combination 3. Permanent load + wind 60 [m/s] (1.0; 1.0)

Combination 4. Permanent load + seismic action (x) + ice (1.0; 1.0; 1.0)

Combination 5. Permanent load + seismic action (y) + ice (1.0; 1.0; 1.0)

Ice load is taken in the amount of 15% of permanent load.

For the wind speed of 40 m/s the basic action is:

$$w_0 = \frac{v_{\max}^2}{1600} = 1,0 \text{ [kN/m}^2\text{]} \text{ so the actions for the tower segments are:}$$

$$w_3 = 1.0/2.3 \times 8.6 = 3.8 \text{ kN/m}^2$$

$$w_2 = 1.0/2.3 \times 11.6 = 5.0 \text{ kN/m}^2$$

$$w_1 = 1.0/2.3 \times 13.3 = 5.8 \text{ kN/m}^2$$

5. STRUCTURAL CALCULATION


Some of the wind turbine foundation and tower calculation results are shown.

Table of materials

No	Material name	E[kN/m ²]	μ	γ [kN/m ³]	α [1/C]	Em[kN/m ²]	μ m
1	Beton MB 40	3.400e+7	0.20	25.00	1.000e-5	3.400e+7	0.20
2	Beton MB 45	3.500e+7	0.20	25.00	1.000e-5	3.500e+7	0.20
3	Čelik	2.100e+8	0.30	78.50	1.000e-5	2.100e+8	0.30

Plate sets

No	d[m]	e[m]	Material	Calculation type	Orthotropy	E2[kN/m ²]	G[kN/m ²]	α
<1>	0.620	0.310	1	Thick plate	Isotropic			
<2>	0.860	0.550	1	Thick plate	Isotropic			
<3>	1.100	0.790	1	Thick plate	Isotropic			
<4>	1.350	1.040	1	Thick plate	Isotropic			
<5>	1.590	1.280	1	Thick plate	Isotropic			
<6>	1.830	1.520	1	Thick plate	Isotropic			
<7>	1.980	1.670	1	Thick plate	Isotropic			
<8>	2.500	2.190	2	Thick plate	Isotropic			

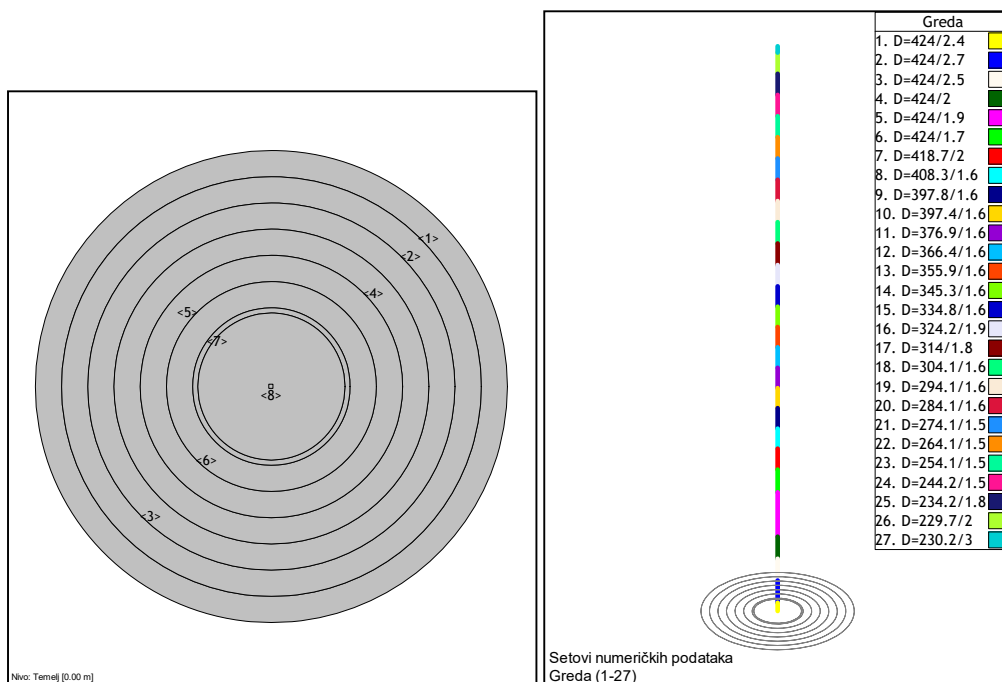

Jelčić, M., Kožul, M.

An example of wind turbine structure**List of load cases**

LC	Name
1	Permanent (g)
2	Ice
3	Wind 40 m/s
4	Wind 60 m/s
5	Sx
6	Sy
7	SRSS: V+VI
8	Comb.: 1.35xI+1.5xII
9	Comb.: 1.35xI+1.5xIII
10	Comb.: I+IV
11	Comb.: I+II+VI
12	Comb.: I+II+V

Point loads

No	LC	X [m]	Y [m]	Z [m]	Px [kN]	Py [kN]	Pz [kN]	Mx [kNm]	My [kNm]	Mz [kNm]
1	1	9.0000	9.0000	75.910			-1175.0			
2	2	9.0000	9.0000	75.910			-177.00			
3	3	9.0000	9.0000	75.910	219.00					
4	4	9.0000	9.0000	75.910	503.80					


Load factors for calculation of masses


No	Name	Coefficient
1	Permanent (g)	1.00
2	Ice	1.00
3	Wind 40 m/s	0.00
4	Wind 60 m/s	0.00

Structure oscillation periods

No	T [s]	f [Hz]
1	3.3231	0.3009
2	3.3231	0.3009
3	0.3980	2.5128
4	0.3980	2.5128
5	0.1381	7.2402
6	0.1381	7.2402
7	0.0700	14.2946
8	0.0700	14.2946
9	0.0430	23.2645
10	0.0430	23.2645
11	0.0297	33.6649
12	0.0297	33.6649
13	0.0268	37.2446
14	0.0268	37.2446
15	0.0263	37.9925

Jelčić, M., Kožul, M.
An example of wind turbine structure

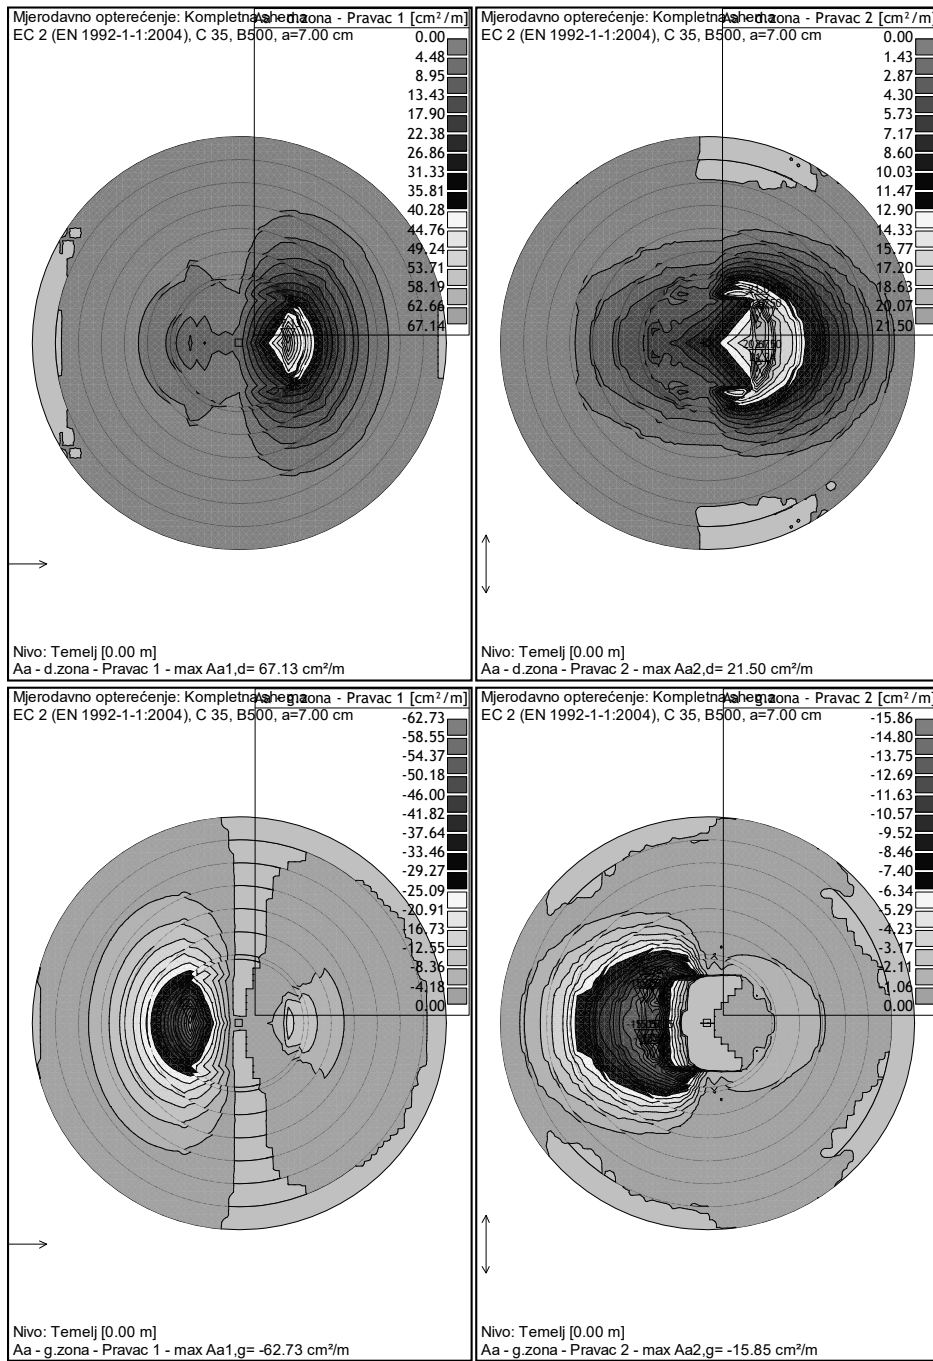

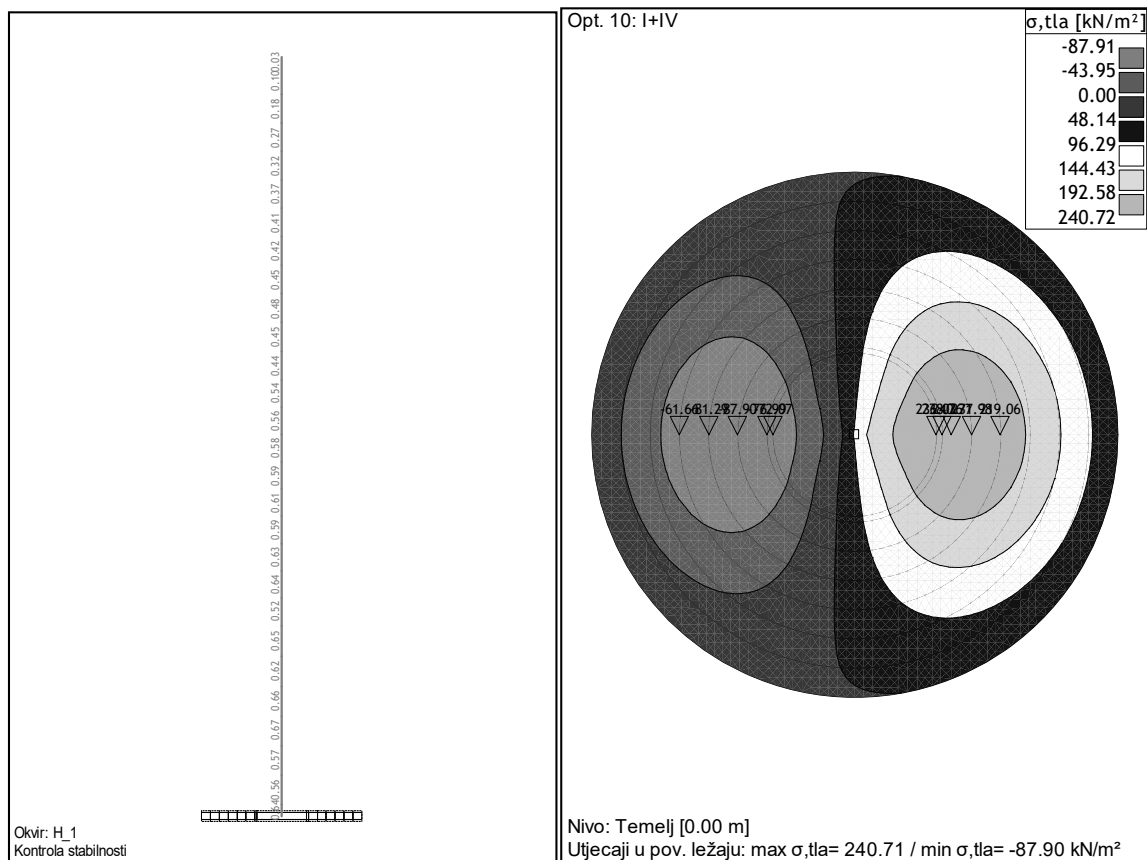

6. CONCLUSION

Preliminary structural calculation of the wind turbine structure (foundation and tower) was performed here. Soil characteristics, wind load data, as well as the seismic zone in which the structure is located were available. Selecting the type of structure is a complex task for wind power plants. The decision is influenced by economic and environmental factors, the type of structure, and the shape and size of the wind turbine. An inverted pendulum system was selected for this structure. Therefore, the purpose of this work was to perform the calculation of this structural system and check whether it meets the load-bearing capacity and stability requirements.

The calculation was performed according to the load bearing capacity on the spatial model, in the computer program Tower 7. That model will rarely be a true picture of actual behavior of the structure. These are always only more or less rough approximations or simplified realities.

The structural calculation was performed on all load-bearing structural elements and on the basis of the obtained results we can conclude that the structural system meets the prescribed load-bearing capacity and structural stability criteria. In the analysis of the obtained effects, there were no deviations from the values allowed by the rules. Accordingly, it is possible to assume that the subject structure will perform well in reality.

REFERENCES

1. Eurocode 0, Basis of structural design, CEN European Committee for Standardization, Brussels, EN 1990: 2002.
2. EN 1991: Eurokod 1 – Djelovanja na konstrukcije (EN 1991:2002).
3. Eurocode 8 – Design of structures for earthquake resistance – Part 1: General rules, seismic actions and rules for buildings, European Committee for Standardization, CEN, Brussels, EN 1998-1: 2004.
4. N. Čupin – Nova energetika – energetika u službi gospodarstva, Zagreb, 2013.
5. M. Čaušević – Dinamika konstrukcija – diskretni sustavi, Zagreb, 2005.
6. Građevinar 57 (2005) 6.
7. A. Štefulj – Završni rad – Vjetroelektrane, Rijeka, 2015.
8. Građevinar 70 (2018) 12.
9. Građevinar 69 (2017) 1.
10. Obnovljiva energija - https://hr.wikipedia.org/wiki/Obnovljiva_energija#Energija_vjetra.
11. D. Županić – Diplomski rad, Zagreb, 2015.
12. International Standard – IEC 61400-1; Wind turbines – part 1: Design requirements